

Air Intake Filter Specification Template

FOR PRICING SEND TO:


EMAIL: ascquoterequest@gmail.com or FAX: 513-860-9785

Evapco Cooling Tower Intake Panels

- Company Name: _____ Contact Name: _____
- Contact Phone Number: _____ Cell: _____ Fax _____
- Email Address: _____ End Customer: _____
- Equipment (Make & Model) _____

IMPORTANT NOTE – Please Read Before Taking Measurements:

Please indicate both the *inside dimension* and *outside dimension (including flange)* of the air intake opening. When you provide both ID and OD measurements, filters will be sized so center of filter fastening grommets will align with the center point of the available fastening surface. **If you do not provide both ID and OD measurements, then the dimensions will require verification prior to production to ensure a perfect fit.** NOTE: Filter size will vary +/- 1/8"

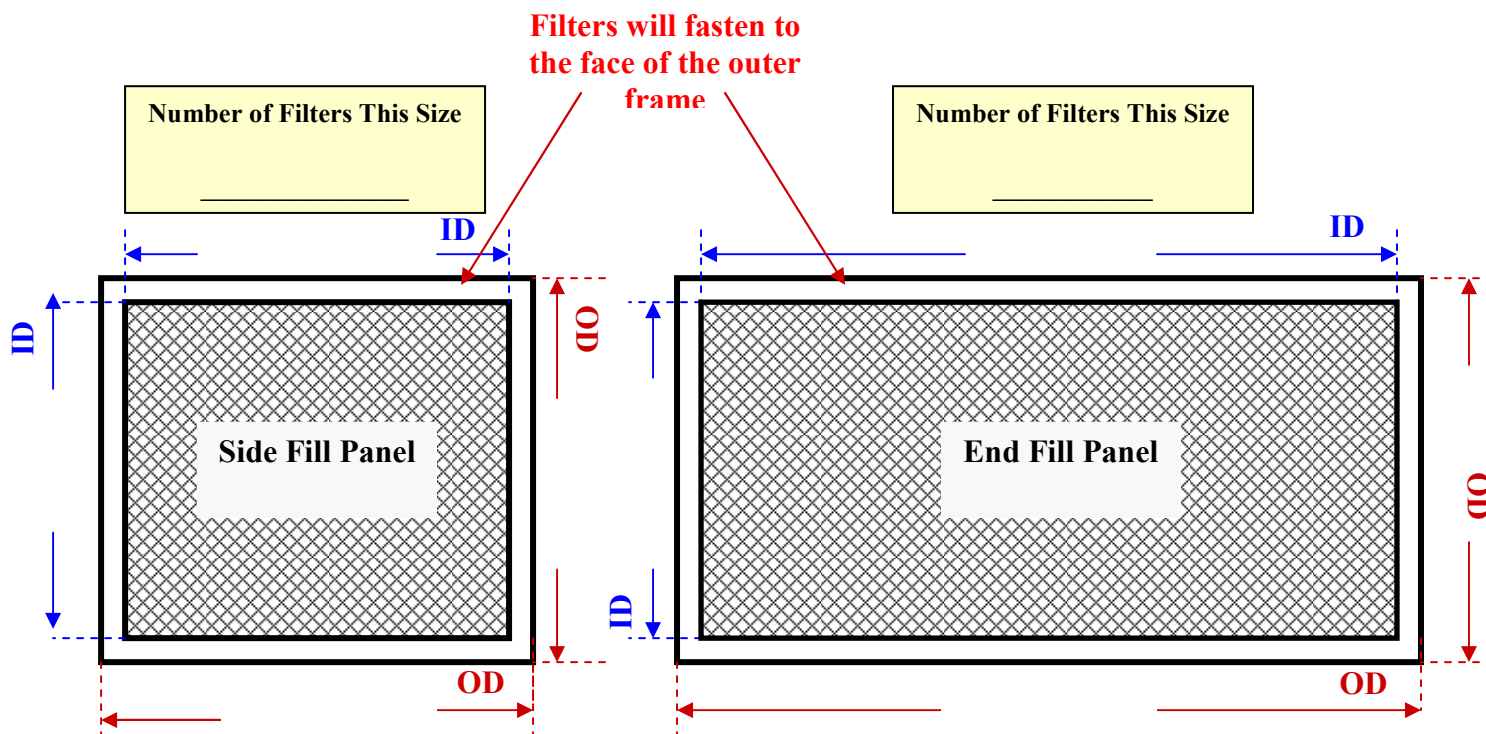

Comments / Instructions (use space on back as needed)

Air Intake Filters Are Manufactured By:
Air Solution and Newway Companies, Commerce Twp, MI 48382
www.airsolutioncompany.com

United States and Foreign Patents Granted - This product is protected under one or more of the following U.S. and foreign patents:
5,370,722 • 5,529,593 • 6,197,077 B1 • 2170244 • 95904185.6-2113, Other Patents Pending.

This template is copyright by Air Solution Company & Newway Company. This template is to only be used for capturing specifications which will be sent to Air Solution Company & Newway Company for purposes of price quotes and production. It may not be sent to any other third party manufacturer for any purpose including price quotation and product replication without written permission of Air Solution Company or Newway Company.