

Air Intake Filter Specification Template

FOR PRICING SEND TO:

EMAIL: ascquoterequest@gmail.com or FAX: 513-860-9785

For Large Chiller Applications: York, McQuay & Similar

PLEASE READ BEFORE TAKING MEASUREMENTS: Filter Screen requirements can vary from unit to unit of the same make and model based on how and where the unit is set. Therefore, verification of specifications is required to ensure that the filter screens being produced for the unit will fit properly and provide years of trouble free service. Please capture all of the measurements that apply as shown below. If you wish to field fit the filter around the pipe, dimensional information is not then needed on the location of the pipe as the holes will be cut on site - (Field fitting instruction will be provided)

Company Name: _____ **Contact:** _____


Tel. _____ **Cell:** _____ **Fax:** _____

Email: _____ **End Customer:** _____

Make: _____ **Model:** _____ **Number of Units Of this model :** _____

Comments: _____


Front & Back Side Dimensions

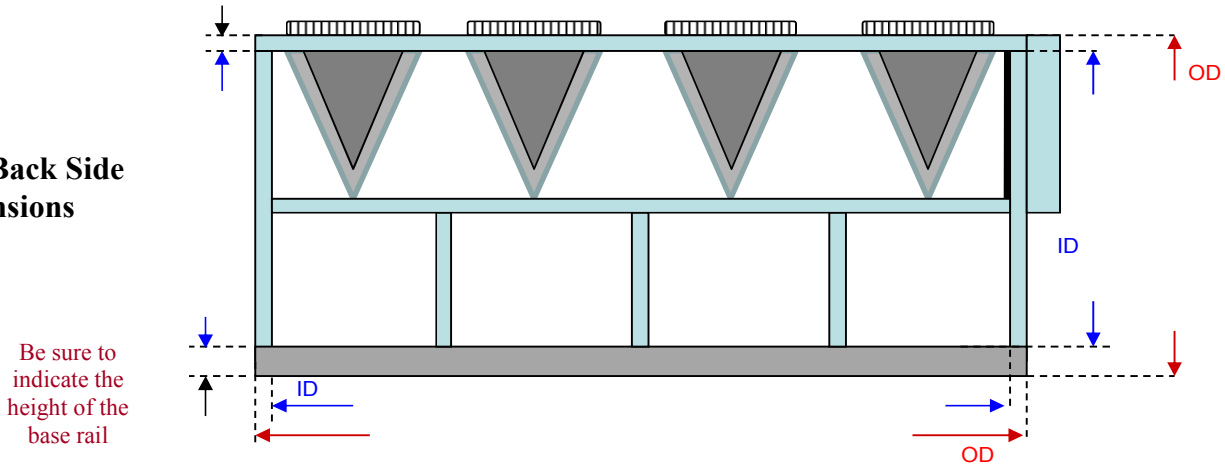

End View

If only bottom ends are open only provide dimensions for the bottom.

If end is open from top to bottom, only indicate full height dimensions.

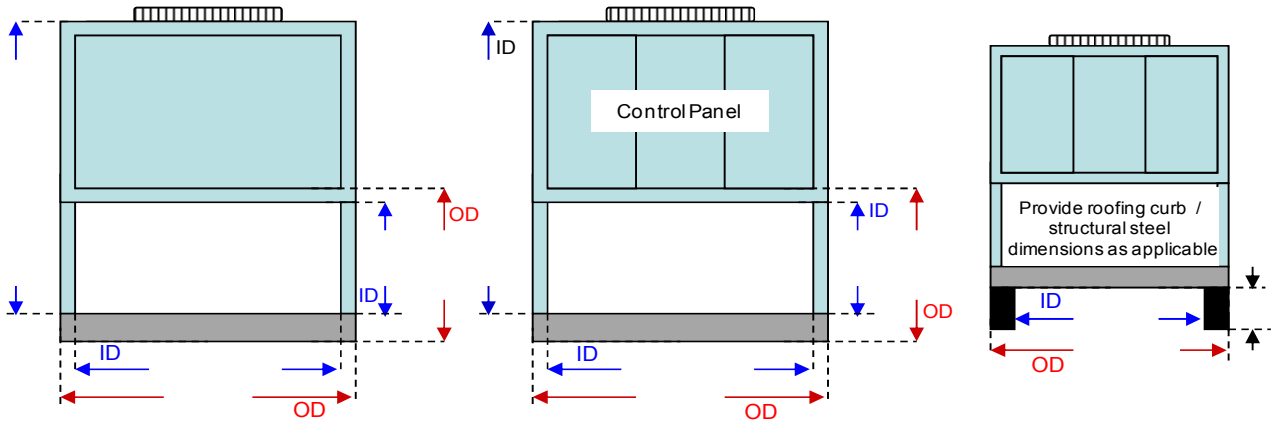

Air Intake Filters Are Manufactured By: The Air Solution and Newway Company, Commerce Twp, MI 48382
www.airsolutioncompany.com

Air Intake Filters are protected under one or more of the following U.S. and foreign patents: 5,370,722 • 5,529,593 • 6,197,077 B1 • 2170244 • 95904185.6-2113 • 7,323,028 • Other Patents Pending.
 This template is copyright by Air Solution Company & Newway Company. This template is to only be used for capturing specifications which will be sent to Air Solution Company & Newway Company for purposes of price quotes and production.
 It may not be sent to any other third party manufacturer for any purpose including price quotation and product replication without written permission of the Air Solution and Newway Company