

Air Intake Filter Specification Template

FOR PRICING SEND TO:
EMAIL: ascquoterequest@gmail.com or FAX: 513-860-9785
Daiken and Mitsubishi Condenser Units

PLEASE READ BEFORE TAKING MEASUREMENTS: Filter Screen requirements can vary from unit to unit of the same make and model based on how and where the unit is set. Therefore, verification of specifications is required to ensure that the filter screens being produced for the unit will fit properly and provide years of trouble free service. Please capture **all** of the measurements that apply as shown below.


Distributor / Company: _____ **Contact:** _____

Tel. _____ **Cell:** _____ **Fax:** _____

Email: _____ **End Customer:** _____

Model Number: _____ **How Many Units of this Model:** _____

**** Filters will attach To the Unit at the Approx. mid point between your ID and OD Measurements ****

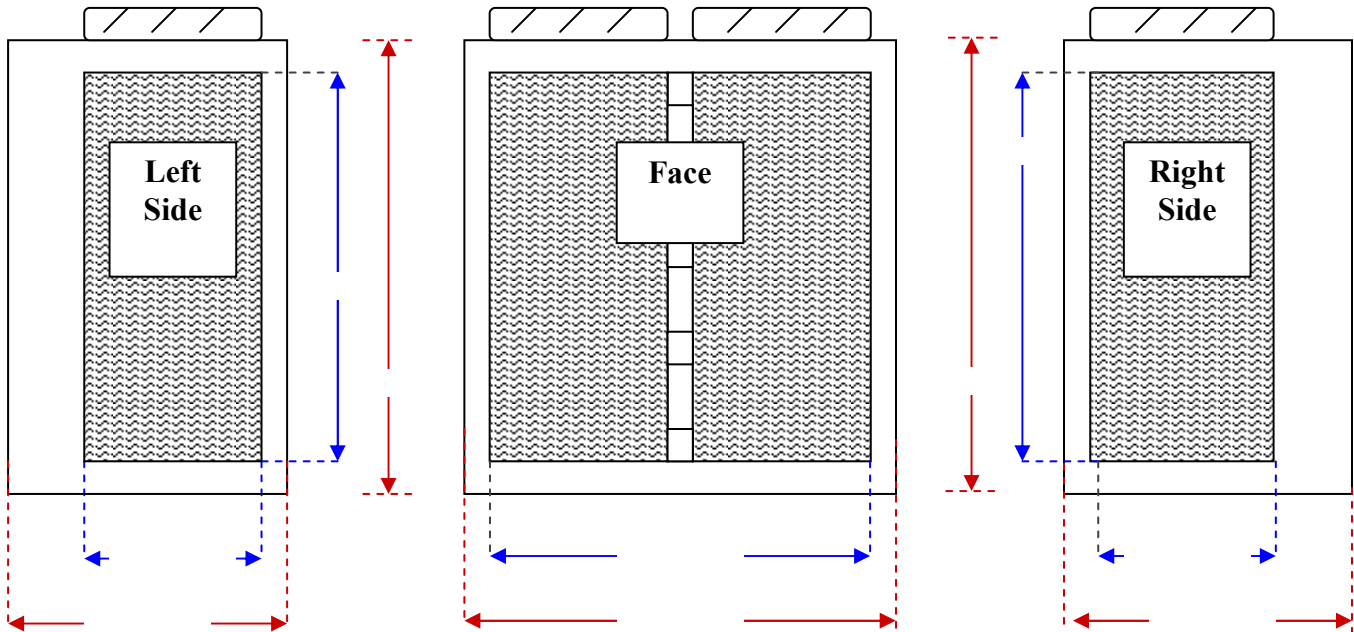

Air Intake Filters Are Manufactured By: Newway Company dba / Air Solution Company Commerce Twp, MI 48382

www.airsolutioncompany.com

Air Intake Filters are protected under one or more of the following U.S. and foreign patents:
5,370,722 • 5,529,593 • 6,197,077 B1 • 2170244 • 95904185.6-2113 • 7,323,028 • Other Patents Pending.

This template is copyright by Air Solution Company & Newway Company. This template is to only be used for capturing specifications which will be sent to Air Solution Company for purposes of price quotes and production. It may not be sent to any other third party manufacturer for any purpose including price quotation and product replication without written permission of the Air Solution Company.